

AN EXAMINATION ON FREE COOLING EFFICIENCY OF DRY COOLERS COMBINED WITH THE CHILLERS IN TANDEM WORK

Hasan ACÜL
Friterm A.S
R&D Department Chief Engineer

ABSTRACT

Increasing energy efficiency is one of the most important points in our era. Becoming a matter of primary importance in air conditioning, industrial, commercial and process cooling applications, energy efficiency affects designs of the systems included dry coolers and water chillers. Besides, legislations and restrictions on energy efficiency also urge manufacturers to develop high performance, energy efficient, environment friendly, economic and long life products. In these purposes, the tendency towards alternative energy efficient systems, which use natural resources, is increasing. Free cooling is one of the natural resourced methods for energy efficiency. This paper is intended to provide information on free cooling efficiency with a theoretically examination of A, C and E energy class dry coolers combined with the chillers in tandem work in air conditioning application.

1. INTRODUCTION

Heating is required in the buildings in Winter and Fall, whereas cooling is also be needed for some parts inside such as large computer and server rooms, internet and telecommunication data bases, conference rooms, some parts of shopping malls, crowded places, etc. These are the typical examples of places that require cooling also in winter.

As outside ambient temperatures drop below the required cooling water temperatures, free cooling systems can be used and considerable energy saving gained. The system of free cooling, which reduces operational costs with the increase in efficiency, entirely or partially eliminates the need for compressor work of the chiller at low ambient temperature periods. Dry cooler systems have an important function in energy efficiency, operating either with a chiller or independently according to application.

Free Cooling Systems can be grouped in two basic categories as *Air-Side Free Cooling* and *Water-side Free Cooling* systems. [1]: Free Cooling for Air-Side Cooling System Applications include reducing the costs of energy consumption via using directly the ambient air to cool the inner environment at low ambient temperatures. Free Cooling for Water-Side Cooling System Applications include reducing the costs of cold water production provided by chiller. Free cooling, employed in systems which require cooling water, obtains cooling water without operating or partially operating the chiller compressor by taking advantage of the low ambient temperature [1], [2].

Widely part of the products that are used in free cooling includes the finned block heat exchangers which can be applied in two ways that

1. Free Cooling Chillers (Integrated Free Cooling Coil) Applications
2. Dry Cooler Applications


These systems can be used as the ambient temperature drops 1.5 - 2.0°C below the required cooling water temperature. The working principle of the system can be defined by three different approaches as

1. 100% Mechanical Cooling (Chiller are in operation. No Free Cooling Application.)

2. Partially Free Cooling (Load sharing, Pre-cooling. When the ambient temperature falls below 1,5 -2.0 °C of the required cooling water temperature, the load can be shared between dry cooler and chiller compressor.)
3. 100% Free Cooling (Chiller compressor does not work. 100% Free cooling can be possible when the ambient temperature drops below at least 5 °C of the required cooling water.)


2. FREE COOLING CHILLERS (INTEGRATED FREE COOLING COIL) APPLICATIONS

In figure 1.A a photo, in figure 1.B a basic scheme of free cooling chiller is shown. The free cooling coil is placed in the front side of the air cooled condenser coil depending on the air flow direction of the unit. The control systems commands and directs the return water to the free cooling coil for pre-cooling or fully free cooling as the ambient temperature drops below required water temperature.

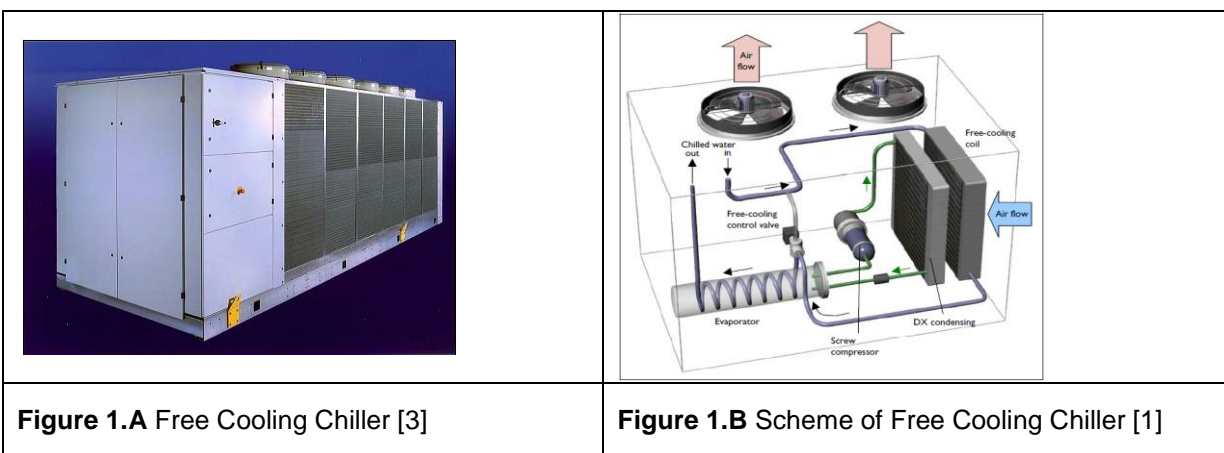

3. DRY COOLER APPLICATIONS

Another finned block heat exchanger system used in cooling applications is called as Dry Cooler (fig 2). Dry Coolers have wide application area in air conditioning and process water cooling systems. The working principle is transferring the return water load to the air by the aid of finned heat exchanger and fans. In this system the fin surface of the exchanger is dry. Relatively there is no risk of corrosion on the fins. Besides, depletion of the cooling water and associated health risks (such as legionella bacteria) is also eliminated by the closed-loop working of the system.

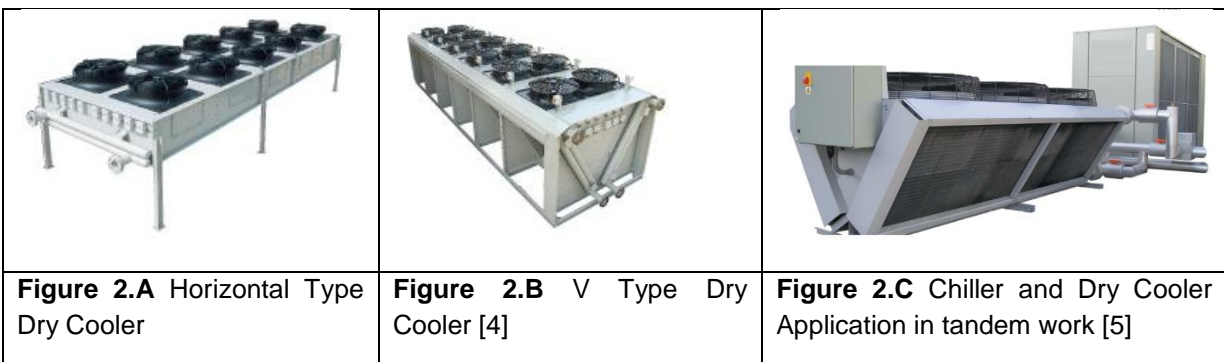

Cooling of the water temperature in the dry coolers depends on the ambient dry bulb temperature, thus they are called as dry coolers. By using the dry coolers, cooling of the water can be achieved approximately 5 °C over the ambient dry bulb temperature. To have lower temperatures wet-dry coolers are used. Dry coolers are preferred as free coolers for their energy saving advantages in computer and server rooms which require cooling for 24 hours, internet and telecommunication data centers, certain parts of shopping malls and business centers where energy is intensely used. Specially, the system provides huge savings during the night period.

4. A THEORETICALLY EXAMINATION ON FREE COOLING EFFICIENCY OF DRY COOLERS COMBINED WITH THE CHILLERS IN TANDEM WORK IN AIR CONDITIONING APPLICATION

In order to calculate energy efficiency, a scenario is scripted for the dry coolers which have A, C and E energy classes working in Ankara city, Turkey. Besides that, via using the same method, calculations are also made for other 79 cities located in different regions of Turkey and energy efficiency results are given in Table 5.

All of the scripted scenario assumptions are indicated below:

1. The place which requires cooling is assumed as a combined business and shopping center. Due to the intensive energy characteristics of the place, even in the Winter, Spring and Fall seasons cooling is required.
2. Cooling demand assumed for 16 hours/365 days.
3. The total cooling load is assumed to be fixed as 130 kW through the whole year. (For easy understanding of the calculations the effects of seasonal changes are neglected).
4. It is assumed that the cooling is made by the VAV devices which can respond to the variable cooling loads and ceiling type fan coils and packed-type AHUs in certain parts.
5. Cooling water regime is assumed as 12 °C / 16 °C.
6. The calculations and comparisons are taken below 16 °C as free cooling range.
7. Calculations and tables are made for Ankara city, Turkey. For other 79 cities located in different regions of Turkey the same calculation methods are applied.
8. The bin weather data for those cities are taken from Turkish State Meteorological Service (TSMS) sources [6].
9. Working conditions of scripted scenario is assumed as follows:
 - 100% Mechanical Cooling Temperature Zone: When the ambient temperature is above the return water temperatures ($T_{\text{ambient}} \geq 15 \text{ °C}$), 100% mechanical cooling is required. Condenser fans and compressor is to work.
 - Partial Free Cooling (Precooling/Load sharing) Temperature Zone: As the ambient air temperature drops at least 2 °C below the return water temperature (16 °C -2°C =14 °C) , the dry cooler begins to function as the pre-cooler. Working condition is that ambient temperature (T_{ambient}) should be between 14 °C and 7 °C. Due to the decrease in the return water temperature which is sent to the water cooler group, compressor and condenser load displays a proportional decrease.
 - 100% Free Cooling Temperature Zone: When the ambient temperature is at least 5 °C below cooling water temperature ($T_{\text{ambient}} \leq (12 \text{ °C} -5\text{°C}) 7 \text{ °C}$) only the dry cooler is in operation. Chiller is not running.
10. The compressor of chiller is assumed to be frequency controlled. However, for the ease of the calculations certain temperatures and the ratios are used. It should be also considered that the gain calculated via frequency control would higher than the given values. Besides, the dry cooler fans and the condenser fans are considered as step controlled.

11. In order to clearly indicate the effects of dry cooler energy efficiency levels on consumption and costs, calculations are made for 3 different energy efficiency classes as A class, C class and E class.

Additional information on Energy Efficiency Classes:



Dry cooler capacity standard is EN 1048 Heat Exchangers-Air Cooled Liquid Coolers "Dry Coolers"-Test Procedure for Establishing the Performance.

Energy efficiency levels are indicated in EUROVENT Rating Standard For Forced Convection Air Cooled Liquid Coolers "Dry Coolers" 7/C/003 – 2010 [7].

Table 1. Energy Efficiency Class [7]

| Class | Energy Consumption | Energy Ratio (R)* |
|-------|--------------------|-------------------|
| A | Extremely low | $R \geq 110$ |
| B | Very low | $70 \leq R < 110$ |
| C | Low | $45 \leq R < 70$ |
| D | Medium | $30 \leq R < 45$ |
| E | High | $R < 30$ |

* The energy ratio "R" is obtained by dividing the *standard capacity* of the product by the total energy consumption of unit.

12. Tandem working scenario of Dry cooler and Chiller by temperature intervals is shown in Table 2 in which values are only for A energy efficiency class dry cooler. Values differ for C and E energy class dry cooler applications. Detailed calculation values for A, C and E class dry coolers are displayed in Table 3.

| Repeated Temperature Frequency (hour/Year) | 2 | 14 | 52 | 140 | 318 | 575 | 823 | 878 | 876 | 851 | 866 | 899 | | | | | | | | | | | | |
|--|---|---------|--------|----------------------------------|-------|-------|----------------------------------|-------|-----------------------------|-----------------------------------|-------|--------|--------------------|--|---------|---|--|---------|---|--|--|--|--|--|
| | Frequency for 16 hours of working per day (hour/Year) | 1,3 | 9,3 | 34,7 | 93,3 | 212,0 | 383,3 | 548,7 | 585,3 | 584,0 | 567,3 | 577,3 | 599,3 | | | | | | | | | | | |
| Temperature Interval (°C) | -18/-15 | -15/-12 | -12/-9 | -9/-6 | -6/-3 | -3/0 | 0 / 3 | 3 / 6 | 6 / 9 | | | 9 / 12 | | | 12 / 15 | | | 15 / 18 | | | | | | |
| | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | | | | | | | | | | | | | | | |
| Working Zone | 100% Free Cooling 4 Fans Work | | | 100% Free Cooling 6 Fans Work | | | 100% Free Cooling 8 Fans Work | | | 100% Free Cooling 10 Fans Work | | | %20 MC (4 Fans) | | | % 45 Mechanical Cooling (6 Fans) | | | % 72 Mechanical Cooling (8 Fans) | | | % 100 Mechanical Cooling Zone (8 Fans) | | |
| | 80% Free Cooling (10 Fans) | | | 55% Free Cooling (10 Fans) | | | %28 FC (10 Fans) | | | Partially Free Cooling Side | | | | | | | | | | | | | | |
| %100 Free Cooling Side | | | | | | | | | Partially Free Cooling Side | | | | | | | | | | | | | | | |

Notes for Table2:

1. Temperatures used for partial side load and energy consumption calculations are 8,5 °C for 6 / 9°C interval; 11 °C for 9 / 12°C interval; 13,5 °C for 12 / 15°C interval. By pre-cooling of dry cooler (in proportional controlled load) the load that compressor is subjected are %20, %45 and %72 respectively.
2. As ambient air temperature decreases chiller and dry cooler fans are step controlly stopped and the consumption of the fans decrease. (The temperatures determined for the step control of the fans differ approximately 1-2 °C than the indicated temperature intervals in the real conditions, the meteorological temperature intervals are accepted as main intervals for the easy calculations.)

13.Capacity, load sharing and energy consumption values of the dry cooler and the chiller are given in the Table 3.A in accordance with the certain temperatures. Values are only for A energy efficiency class dry cooler. (Please also see detailed explanations for Tables 3A and 3B below.)

| Working Zone | Ambient Temperature intervals (°C) | Dry Cooler Capacity (kW) | Dry Cooler Power (kW) | Dry Cooler Capacity / Power Ratio | Dry Cooler Load (%) | Compressor Capacity (kW) | Compressor power (kW) | Compressor Capacity / Power Ratio | Compressor Load (%) | Condenser Fan Power (kW) | Total Power of the Cooling Group (kW) | Dry Cooler+ Chiller Power (kW) | Total Cooling Capacity of the system(kW) |
|--------------------------------|------------------------------------|--------------------------|-----------------------|-----------------------------------|---------------------|--------------------------|-----------------------|-----------------------------------|---------------------|--------------------------|---------------------------------------|--------------------------------|--|
| %100 Mechanical Cooling | Above 15°C | 0 | 0,00 | 0,0 | 0,0% | 132,1 | 17,3 | 7,6 | 100,0% | 6,24 | 23,54 | 23,54 | 132,1 |
| | 13-14°C | 36,21 | 2,00 | 18,1 | 27,4% | 96,3 | 12,2 | 7,9 | 72,9% | 6,24 | 18,44 | 20,44 | 132,51 |
| Partial Cooling | (9/12) 10-11-12°C | 72,7 | 2,00 | 36,4 | 55,0% | 60,2 | 8 | 7,5 | 45,6% | 4,68 | 12,68 | 14,68 | 132,9 |
| | 8-9°C | 109,5 | 2,00 | 54,8 | 82,9% | 26,4 | 3,46 | 7,6 | 20,0% | 3,12 | 6,58 | 8,58 | 135,9 |
| | 3 / 7°C | 132,1 | 2,00 | 66,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 2,00 | 132,1 |
| % 100 Free Cooling | 0 / 3°C | 132,1 | 1,60 | 82,6 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 1,60 | 132,1 |
| | -3 / 0°C | 132,1 | 1,60 | 82,6 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 1,60 | 132,1 |
| | -6 / -3°C | 132,1 | 1,20 | 110,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 1,20 | 132,1 |
| | -9 / -6°C | 132,1 | 1,20 | 110,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 1,20 | 132,1 |
| | -12 / -9°C | 132,1 | 0,80 | 165,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 0,80 | 132,1 |
| | -15 / -12°C | 132,1 | 0,80 | 165,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 0,80 | 132,1 |
| | -18 / -15°C | 132,1 | 0,80 | 165,1 | 100,0% | 0 | 0 | - | 0,0% | 0 | 0,00 | 0,80 | 132,1 |

14. Energy consumption calculations of A, C and E class dry coolers and chiller (according to scenarios) are given in Table 3B which is calculation table for energy consumption values of both Tables 2.A and Table 4.

| TABLE 3B. POWER CALCULATIONS FOR THE WORKING SCENARIOS | | | | | | | | | | | | | | | | | | |
|---|---------|---------|--------|-------|-------|------|-------|-------|--|-------|-------|---|----|----|-------|----|----|-------|
| Temperature Interval (°C) | -18/-15 | -15/-12 | -12/-9 | -9/-6 | -6/-3 | -3/0 | 0 / 3 | 3 / 6 | 6 / 9 | | | 9 / 12 | | | 12/15 | | | 15/18 |
| | | | | | | | | | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | |
| POWER CALCULATION FOR CHILLER IN %100 MECHANICAL COOLING SCENARIO | | | | | | | | | | | | | | | | | | |
| Compressor Power (%100) (kw) * | 14,83 | | | | | | | | 14,83 | 15,61 | 16,44 | 17,30 | | | | | | |
| Fan Power (kw) * | 3,12 | | | | | | | | 3,12 | 4,68 | 6,24 | 6,24 | | | | | | |
| Chiller Power (kw) | 17,95 | | | | | | | | 17,95 | 20,29 | 22,68 | 23,54 | | | | | | |
| * As ambient temperature decreases, compressor efficiency increases and condenser fans are stopped as in step control. | | | | | | | | | | | | | | | | | | |
| POWER CALCULATIONS FOR CHILLER IN PARTIALLY COOLING SCENARIO | | | | | | | | | | | | | | | | | | |
| Compressor Power (%100) (kw) * | 0,00 | | | | | | | | 3,46 | 8,00 | 12,20 | - | | | | | | |
| Fan Power (kw) * | 0,00 | | | | | | | | 3,12 | 4,68 | 6,24 | - | | | | | | |
| Chiller Power (kw) | 0,00 | | | | | | | | 6,58 | 12,68 | 18,44 | 0,00 | | | | | | |
| POWER CALCULATIONS FOR "A CLASS" DRY COOLER IN %100 FREE COOLING AND PARTIAL COOLING SCENARIOS | | | | | | | | | | | | | | | | | | |
| Fan Power(kw) ** | 0,80 | 0,80 | 0,80 | 1,20 | 1,20 | 1,60 | 1,60 | 2,00 | 2,00 | 2,00 | 2,00 | 0,00 | | | | | | |
| **As ambient air temperature decreases chiller and dry cooler fans are step controllly stopped and the consumption of the fans decrease. (The temperatures determined for the step control of the fans differ approximately 1-2 °C than the indicated temperature intervals in the real conditions, the meteorological temperature intervals are accepted as main intervals for the easy calculations.) | | | | | | | | | | | | | | | | | | |
| TOTAL POWER CALCULATIONS FOR A CLASS DRY COOLER AND CHILLER IN PARTIALLY COOLING | | | | | | | | | | | | | | | | | | |
| Total Power (kw) | 0,80 | 0,80 | 0,80 | 1,20 | 1,20 | 1,60 | 1,60 | 2,00 | 8,58 | 14,68 | 20,44 | 0,00 | | | | | | |
| POWER CALCULATIONS FOR "C CLASS" DRY COOLER IN %100 FREE COOLING AND PARTIALLY COOLING SCENARIOS | | | | | | | | | | | | | | | | | | |
| Fan Power (kw) ** | 1,32 | 1,32 | 1,98 | 1,98 | 2,64 | 2,64 | 3,30 | 3,96 | 3,96 | 3,96 | 3,96 | 0,00 | | | | | | |
| **As ambient air temperature decreases chiller and dry cooler fans are step controllly stopped and the consumption of the fans decrease. | | | | | | | | | | | | | | | | | | |
| TOTAL POWER CALCULATIONS FOR C CLASS DRY COOLER AND CHILLER IN PARTIALLY COOLING | | | | | | | | | | | | | | | | | | |
| Total Power (kw) | 1,32 | 1,32 | 1,98 | 1,98 | 2,64 | 2,64 | 3,30 | 3,96 | 10,54 | 16,64 | 22,68 | 0,00 | | | | | | |
| | | | | | | | | | | | | Inefficient in this zone. Thus 100% Mechanical cooling. | | | | | | |
| POWER CALCULATIONS FOR "E CLASS" DRY COOLER IN %100 FREE COOLING AND PARTIALLY COOLING SCENARIOS | | | | | | | | | | | | | | | | | | |
| Fan Power (kw) ** | 4,00 | 4,00 | 4,00 | 6,00 | 6,00 | 8,00 | 8,00 | 10,00 | 10,00 | 10,00 | 10,00 | 0,00 | | | | | | |
| **As ambient air temperature decreases chiller and dry cooler fans are step controllly stopped and the consumption of the fans decrease. | | | | | | | | | | | | | | | | | | |
| TOTAL POWER CALCULATIONS FOR E CLASS DRY COOLER AND CHILLER IN PARTIALLY COOLING | | | | | | | | | | | | | | | | | | |
| Total Power (kw) | 4,00 | 4,00 | 4,00 | 6,00 | 6,00 | 8,00 | 8,00 | 10,00 | 17,95 | 20,29 | 22,68 | 0,00 | | | | | | |
| Under these conditions E class product can only be used in 100% free cooling zone. | | | | | | | | | Under these conditions E class product is not efficient. Thus, 100% mechanical cooling is applied. | | | | | | | | | |

Notes for Table 3A and 3B:

1. As A class dry cooler FRITERM FYKS 80 25 D 4 2,5 D E (10 fans) model; as C class dry cooler FRITERM FYKS 63 26 D 4 3,2 L (12 fans) model; as E class dry cooler FRITERM FYKS 80 15 D 3 2,5 S (5 fans) model selected [4].
2. The compressor is selected frequency controlled RC2-100B Screwed Compressor [8].
3. Condenser is selected as air cooled FRITERM FUH YK 63 24 C 1 2,5 S model.
4. The calculations for the capacity performance in different ambient temperatures are done with the constant flow-rate assumption in dry coolers.
5. Calculation interval is assumed between -18/-15°C and +18/+15°C.
6. Pumping power is not taken into account in comparison calculations.
7. The values above are found via using the producer firms' product selection programs.

15. In Table 4, energy saving calculations are given only for Ankara city. Please see Table 5 for energy efficiency of other 79 cities located in different regions of Turkey.

| TABLE 4. BENEFIT CALCULATION OF TANDEM WORKING SCENERIO(ANKARA) | | | | | | | | | | | | | | | | |
|--|-----------------------------|---------|--------|--------|--------|--------|-----------------------|---------|--------|--------|--------|---------|--|--------|-------|---------|
| Repeated Temperature Frequency (hour/Year) | 2 | 14 | 52 | 140 | 318 | 575 | 823 | 878 | 876 | | | 851 | 866 | | | 899 |
| Frequency for 16 hours of working per day (hour/Year) | 1,3 | 9,3 | 34,7 | 93,3 | 212,0 | 383,3 | 548,7 | 585,3 | 584,0 | | | 567,3 | 577,3 | | | 599,333 |
| Temperature Interval (°C) | -18/-15 | -15/-12 | -12/-9 | -9/-6 | -6/-3 | -3/0 | 0 / 3 | 3 / 6 | 6 / 9 | | | 9 / 12 | 12/15 | | | 15/18 |
| | | | | | | | | | 7 | 8 | 9 | | 13 | 14 | 15 | |
| %100 MECHANICAL COOLING | | | | | | | | | | | | | | | | |
| Energy Consumed (kW/h) | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 17,95 | 20,29 | 22,68 | 22,68 | 23,54 | 23,54 |
| Energy Consumed in Total (kW) | 23,9 | 167,5 | 622,3 | 1675,3 | 3805,4 | 6880,8 | 9848,6 | 10506,7 | 3494,3 | 3494,3 | 3494,3 | 11511,2 | 4364,6 | 4364,6 | - | - |
| Energy cost per hour(€/kWh) | 0,09 € | | | | | | | | | | | | | | | |
| Cost of Consumed Energy (€) | 2 € | 15 € | 56 € | 151 € | 342 € | 619 € | 886 € | 946 € | 314 € | 314 € | 314 € | 1.036 € | 393 € | 393 € | - | - |
| Total Cost of Consumed Energy (€) | 5.783 € | | | | | | | | | | | | | | | |
| PARTIALLY FREE COOLING: COMPARISON WITH "A CLASS" DRY COOLER | | | | | | | | | | | | | | | | |
| Energy Consumed (kW/h) | 0,8 | 0,8 | 0,8 | 1,2 | 1,2 | 1,6 | 1,6 | 2 | 2 | 8,58 | 8,58 | 14,68 | 20,44 | 20,44 | - | - |
| Energy Consumed in Total (kW) | 1,1 | 7,5 | 27,7 | 112,0 | 254,4 | 613,3 | 877,9 | 1170,7 | 1670,2 | 1670,2 | 1670,2 | 8328,5 | 3933,6 | 3933,6 | - | - |
| Cost of Consumed Energy (€) | 0 € | 1 € | 2 € | 10 € | 23 € | 55 € | 79 € | 105 € | 150 € | 150 € | 150 € | 750 € | 354 € | 354 € | - | - |
| Total Cost of Consumed Energy (€) | 2.184 € | | | | | | | | | | | | | | | |
| CALCULATIONS | ANNUAL SAVING (EURO) | | | | | | EFFICIENCY (%) | | | | | | RETURN OF THE INVESTMENT (YEAR) | | | |
| | 3.598 € | | | | | | 62,23% | | | | | | 3,6 | | | |
| PARTIALLY FREE COOLING: COMPARISON WITH "C CLASS" DRY COOLER | | | | | | | | | | | | | | | | |
| Energy Consumed (kW/h) | 1,98 | 1,98 | 1,98 | 2,64 | 2,64 | 3,3 | 3,96 | 3,96 | 3,96 | 10,54 | 10,54 | 16,64 | 22,68 | 22,68 | 23,54 | 23,54 |
| Energy Consumed in Total (kW) | 2,6 | 18,5 | 68,6 | 246,4 | 559,7 | 1265,0 | 2172,7 | 2317,9 | 2051,8 | 2051,8 | 2051,8 | 9440,4 | 4364,6 | 4364,6 | - | - |
| Cost of Consumed Energy (€) | 0 € | 2 € | 6 € | 22 € | 50 € | 114 € | 196 € | 209 € | 185 € | 185 € | 185 € | 850 € | 393 € | 393 € | - | - |
| Total Cost of Consumed Energy (€) | 2.788 € | | | | | | | | | | | | | | | |
| CALCULATIONS | ANNUAL SAVING (EURO) | | | | | | EFFICIENCY (%) | | | | | | RETURN OF THE INVESTMENT (YEAR) | | | |
| | 2.995 € | | | | | | 51,79% | | | | | | 4,1 | | | |
| PARTIALLY FREE COOLING: COMPARISON WITH "E CLASS" DRY COOLER | | | | | | | | | | | | | | | | |
| Energy Consumed (kW/h) | 4 | 4 | 4 | 6 | 6 | 8 | 8 | 10 | 10 | 17,95 | 17,95 | 20,29 | 22,68 | 22,68 | 23,54 | 23,54 |
| Energy Consumed in Total (kW) | 5,3 | 37,3 | 138,7 | 560,0 | 1272,0 | 3066,7 | 4389,3 | 5853,3 | 3494,3 | 3494,3 | 3494,3 | 11511,2 | 4364,6 | 4364,6 | - | - |
| Cost of Consumed Energy (€) | 0 € | 3 € | 12 € | 50 € | 114 € | 276 € | 395 € | 527 € | 314 € | 314 € | 314 € | 1.036 € | 393 € | 393 € | - | - |
| Total Cost of Consumed Energy (€) | 4.144 € | | | | | | | | | | | | | | | |
| CALCULATIONS | ANNUAL SAVING (EURO) | | | | | | EFFICIENCY (%) | | | | | | RETURN OF THE INVESTMENT (YEAR) | | | |
| | 1.639 € | | | | | | 28,34% | | | | | | 5,5 | | | |

TABLE 5. ENERGY SAVINGS IN 79 CITIES OF TURKEY FOR A, C AND E CLASS DRY COOLER

| Cities | | Repeated Temperature Frequency (hour/Year) | | | | | | | | | | | Energy Saving (%) | | | |
|----------------------------|------------|--|---------|--------|-------|-------|------|------|-----|------|------|-------|-------------------|---------|---------|---------|
| Temperature Intervals (°C) | | -18/-15 | -15/-12 | -12/-9 | -9/-6 | -6/-3 | -3/0 | -3/0 | 3/6 | 6/9 | 9/12 | 12/15 | 15/18 | A class | C class | E class |
| 1 | Erzurum | 176 | 246 | 332 | 461 | 601 | 712 | 849 | 772 | 811 | 789 | 712 | 630 | 71% | 61% | 39% |
| 2 | Hakkari | 29 | 88 | 203 | 359 | 599 | 794 | 831 | 659 | 616 | 661 | 630 | 704 | 70% | 60% | 39% |
| 3 | Ardahan | 234 | 333 | 435 | 530 | 623 | 724 | 757 | 793 | 902 | 923 | 760 | 590 | 70% | 60% | 39% |
| 4 | Ağrı | 170 | 213 | 290 | 373 | 572 | 678 | 786 | 671 | 695 | 774 | 728 | 663 | 69% | 60% | 38% |
| 5 | Kars | 202 | 285 | 411 | 504 | 596 | 691 | 775 | 746 | 839 | 900 | 824 | 651 | 69% | 59% | 38% |
| 6 | Muş | 116 | 167 | 233 | 294 | 485 | 683 | 826 | 585 | 631 | 693 | 709 | 695 | 69% | 59% | 37% |
| 7 | Bitlis | 13 | 42 | 114 | 252 | 474 | 858 | 1085 | 788 | 734 | 795 | 770 | 689 | 68% | 57% | 35% |
| 9 | Van | 22 | 70 | 149 | 287 | 470 | 748 | 941 | 827 | 781 | 803 | 785 | 802 | 67% | 57% | 34% |
| 8 | Bayburt | 102 | 186 | 300 | 433 | 577 | 728 | 843 | 805 | 887 | 978 | 881 | 694 | 67% | 57% | 34% |
| 10 | Bingöl | 21 | 48 | 98 | 198 | 368 | 639 | 917 | 768 | 722 | 704 | 682 | 696 | 67% | 56% | 33% |
| 12 | Tunceli | 21 | 42 | 85 | 175 | 300 | 534 | 911 | 791 | 743 | 710 | 694 | 691 | 66% | 55% | 33% |
| 11 | Iğdır | 22 | 48 | 104 | 207 | 440 | 723 | 691 | 649 | 661 | 724 | 740 | 787 | 66% | 55% | 33% |
| 13 | Erzincan | 29 | 61 | 131 | 253 | 425 | 639 | 781 | 787 | 812 | 820 | 795 | 812 | 65% | 55% | 32% |
| 15 | Elazığ | 3 | 16 | 53 | 136 | 305 | 573 | 836 | 837 | 787 | 750 | 692 | 705 | 65% | 54% | 32% |
| 14 | Sivas | 54 | 98 | 178 | 292 | 460 | 658 | 865 | 844 | 859 | 934 | 947 | 808 | 64% | 54% | 32% |
| 16 | Yozgat | 17 | 52 | 122 | 272 | 467 | 680 | 940 | 930 | 894 | 928 | 984 | 838 | 64% | 54% | 31% |
| 18 | Çankırı | 8 | 22 | 60 | 167 | 358 | 659 | 943 | 874 | 826 | 831 | 869 | 867 | 64% | 54% | 30% |
| 17 | Konya | 9 | 33 | 76 | 169 | 373 | 643 | 796 | 847 | 843 | 808 | 808 | 835 | 64% | 54% | 30% |
| 19 | Kayseri | 28 | 61 | 121 | 237 | 416 | 680 | 804 | 804 | 864 | 907 | 886 | 780 | 64% | 53% | 30% |
| 21 | Malatya | 0 | 4 | 32 | 103 | 253 | 540 | 795 | 833 | 792 | 728 | 693 | 715 | 63% | 53% | 30% |
| 20 | Gümüşhane | 20 | 47 | 113 | 261 | 475 | 702 | 859 | 846 | 890 | 946 | 995 | 940 | 63% | 53% | 30% |
| 22 | Kastamonu | 2 | 17 | 55 | 133 | 378 | 802 | 1034 | 940 | 903 | 965 | 996 | 866 | 63% | 53% | 30% |
| 23 | Eskişehir | 2 | 12 | 52 | 168 | 365 | 708 | 870 | 887 | 904 | 876 | 920 | 886 | 63% | 53% | 29% |
| 24 | Kırşehir | 13 | 39 | 83 | 182 | 347 | 579 | 824 | 825 | 847 | 872 | 861 | 903 | 63% | 52% | 29% |
| 25 | Çorum | 8 | 16 | 55 | 153 | 348 | 664 | 950 | 899 | 918 | 948 | 943 | 862 | 62% | 52% | 29% |
| 26 | Kırıkkale | 5 | 12 | 33 | 118 | 278 | 561 | 833 | 885 | 842 | 823 | 826 | 890 | 62% | 52% | 28% |
| 28 | Ankara | 2 | 14 | 52 | 140 | 318 | 575 | 823 | 878 | 876 | 851 | 866 | 899 | 62% | 52% | 28% |
| 27 | Nevşehir | 11 | 35 | 95 | 224 | 372 | 545 | 807 | 959 | 937 | 954 | 946 | 866 | 62% | 52% | 28% |
| 29 | Niğde | 20 | 42 | 97 | 198 | 341 | 586 | 776 | 814 | 879 | 912 | 919 | 907 | 62% | 52% | 28% |
| 30 | Afyon | 2 | 13 | 63 | 149 | 332 | 598 | 797 | 917 | 947 | 916 | 924 | 893 | 62% | 51% | 28% |
| 31 | Kütahya | 2 | 13 | 45 | 144 | 343 | 652 | 822 | 937 | 969 | 968 | 976 | 926 | 61% | 51% | 27% |
| 32 | Aksaray | 9 | 29 | 73 | 159 | 283 | 511 | 753 | 793 | 892 | 883 | 881 | 896 | 61% | 50% | 27% |
| 33 | Karaman | 17 | 36 | 70 | 162 | 336 | 520 | 654 | 811 | 914 | 907 | 874 | 881 | 61% | 50% | 27% |
| 34 | Isparta | 0 | 2 | 20 | 86 | 240 | 528 | 802 | 939 | 1078 | 975 | 844 | 833 | 60% | 50% | 26% |
| 35 | Diyarbakır | 4 | 9 | 25 | 64 | 177 | 379 | 666 | 787 | 864 | 797 | 701 | 650 | 60% | 49% | 26% |
| 36 | Bolu | 3 | 20 | 45 | 105 | 275 | 667 | 925 | 901 | 985 | 1061 | 1090 | 946 | 60% | 49% | 25% |
| 37 | Uşak | 0 | 0 | 7 | 50 | 186 | 423 | 748 | 981 | 1065 | 940 | 873 | 876 | 59% | 48% | 24% |
| 38 | Edirne | 0 | 2 | 13 | 55 | 166 | 414 | 749 | 880 | 871 | 864 | 886 | 961 | 59% | 48% | 24% |
| 39 | Siirt | 0 | 1 | 10 | 30 | 79 | 281 | 670 | 869 | 890 | 782 | 685 | 644 | 59% | 48% | 24% |

TABLE 5. ENERGY SAVINGS IN 79 CITIES OF TURKEY FOR A, C AND E CLASS DRY COOLER

| Cities | | Repeated Temperature Frequency (hour/Year) | | | | | | | | | | | Energy Saving (%) | | | |
|----------------------------|---------------|--|---------|--------|-------|-------|------|--------|-------|-------|--------|-------|-------------------|----------|----------|----------|
| Temperature Intervals (-C) | | -18/-15 | -15/-12 | -12/-9 | -9/-6 | -6/-3 | -3/0 | -3 / 0 | 3 / 6 | 6 / 9 | 9 / 12 | 12/15 | 15/18 | A Sınıfı | C Sınıfı | E Sınıfı |
| 40 | Mardin | 0 | 0 | 1 | 19 | 99 | 297 | 613 | 881 | 870 | 798 | 664 | 620 | 59% | 48% | 24% |
| 41 | Burdur | 0 | 0 | 4 | 52 | 176 | 406 | 689 | 949 | 1077 | 935 | 841 | 867 | 58% | 48% | 24% |
| 42 | Bilecik | 0 | 0 | 3 | 26 | 174 | 491 | 811 | 904 | 923 | 936 | 975 | 1088 | 58% | 48% | 23% |
| 43 | Amasya | 2 | 4 | 8 | 36 | 147 | 428 | 751 | 874 | 887 | 888 | 903 | 987 | 58% | 48% | 23% |
| 44 | Artvin | 0 | 0 | 2 | 30 | 159 | 477 | 846 | 915 | 892 | 929 | 1037 | 1231 | 58% | 47% | 23% |
| 45 | G.Antep | 0 | 0 | 2 | 20 | 84 | 294 | 638 | 920 | 958 | 857 | 738 | 705 | 58% | 47% | 22% |
| 46 | Tokat | 3 | 7 | 21 | 71 | 209 | 476 | 767 | 807 | 885 | 1003 | 1019 | 1028 | 57% | 47% | 22% |
| 47 | Kırklareli | 0 | 1 | 9 | 55 | 140 | 359 | 770 | 883 | 905 | 964 | 938 | 963 | 57% | 47% | 22% |
| 48 | Karabük | 0 | 0 | 0 | 10 | 109 | 381 | 750 | 948 | 965 | 934 | 1054 | 1085 | 56% | 46% | 22% |
| 49 | Batman | 0 | 5 | 20 | 34 | 96 | 273 | 540 | 755 | 871 | 847 | 756 | 705 | 56% | 45% | 21% |
| 50 | Bartın | 0 | 0 | 3 | 15 | 74 | 336 | 725 | 969 | 1112 | 1034 | 1063 | 1050 | 55% | 44% | 20% |
| 51 | Balıkesir | 0 | 0 | 1 | 12 | 68 | 251 | 572 | 825 | 1013 | 972 | 932 | 909 | 53% | 43% | 20% |
| 52 | Adıyaman | 0 | 0 | 0 | 6 | 40 | 151 | 464 | 811 | 971 | 887 | 737 | 687 | 53% | 43% | 18% |
| 53 | Bursa | 0 | 0 | 2 | 5 | 36 | 237 | 568 | 810 | 1028 | 981 | 942 | 985 | 53% | 42% | 18% |
| 54 | Kahramanmaraş | 0 | 0 | 0 | 3 | 30 | 155 | 420 | 775 | 977 | 925 | 788 | 708 | 52% | 41% | 17% |
| 55 | Tekirdağ | 0 | 0 | 1 | 14 | 60 | 183 | 498 | 893 | 1074 | 1084 | 969 | 1002 | 52% | 41% | 17% |
| 57 | Adapazarı | 0 | 0 | 0 | 2 | 22 | 152 | 545 | 886 | 1053 | 977 | 1035 | 1090 | 51% | 41% | 17% |
| 56 | Muğla | 0 | 0 | 0 | 4 | 47 | 220 | 487 | 781 | 1153 | 1113 | 868 | 805 | 51% | 41% | 16% |
| 58 | Zonguldak | 0 | 0 | 0 | 0 | 12 | 122 | 505 | 1018 | 1024 | 989 | 1120 | 1228 | 51% | 41% | 16% |
| 59 | Kocaeli | 0 | 0 | 0 | 1 | 14 | 115 | 502 | 852 | 1025 | 978 | 994 | 1097 | 51% | 40% | 16% |
| 60 | Şanlıurfa | 0 | 0 | 0 | 2 | 23 | 99 | 323 | 687 | 951 | 902 | 749 | 657 | 50% | 39% | 16% |
| 61 | Denizli | 0 | 0 | 0 | 3 | 31 | 171 | 418 | 684 | 930 | 1023 | 923 | 848 | 49% | 39% | 16% |
| 62 | İstanbul | 0 | 0 | 0 | 0 | 15 | 95 | 389 | 913 | 1144 | 1090 | 1025 | 983 | 49% | 39% | 15% |
| 63 | Kilis | 0 | 0 | 0 | 0 | 12 | 80 | 298 | 713 | 1059 | 976 | 794 | 733 | 49% | 38% | 14% |
| 64 | Manisa | 0 | 0 | 0 | 0 | 13 | 137 | 363 | 668 | 932 | 973 | 899 | 858 | 49% | 38% | 14% |
| 65 | Yalova | 0 | 0 | 0 | 0 | 8 | 88 | 398 | 836 | 1088 | 1091 | 1042 | 1095 | 48% | 38% | 14% |
| 66 | Çanakkale | 0 | 0 | 0 | 1 | 27 | 152 | 405 | 738 | 981 | 1048 | 1126 | 1017 | 48% | 37% | 14% |
| 67 | Samsun | 0 | 0 | 0 | 0 | 9 | 68 | 350 | 836 | 1177 | 1104 | 1087 | 1134 | 47% | 37% | 13% |
| 68 | Rize | 0 | 0 | 0 | 0 | 3 | 52 | 392 | 820 | 1178 | 1155 | 1067 | 1114 | 47% | 37% | 13% |
| 69 | Ordu | 0 | 0 | 0 | 0 | 3 | 63 | 358 | 811 | 1221 | 1154 | 1089 | 1099 | 47% | 36% | 13% |
| 70 | Sinop | 0 | 0 | 0 | 0 | 4 | 48 | 287 | 845 | 1357 | 1153 | 1074 | 1080 | 47% | 36% | 12% |
| 71 | Trabzon | 0 | 0 | 0 | 0 | 6 | 54 | 286 | 788 | 1205 | 1095 | 1044 | 1141 | 47% | 36% | 12% |
| 72 | Giresun | 0 | 0 | 0 | 0 | 0 | 42 | 290 | 785 | 1252 | 1114 | 1085 | 1123 | 46% | 36% | 12% |
| 73 | Aydın | 0 | 0 | 0 | 0 | 2 | 59 | 245 | 478 | 810 | 1066 | 1082 | 995 | 42% | 31% | 10% |
| 74 | Antakya | 0 | 0 | 0 | 0 | 2 | 35 | 160 | 362 | 736 | 1055 | 992 | 918 | 39% | 29% | 8% |
| 75 | İzmir | 0 | 0 | 0 | 0 | 0 | 25 | 162 | 440 | 749 | 1056 | 1142 | 990 | 39% | 29% | 8% |
| 76 | Antalya | 0 | 0 | 0 | 0 | 0 | 6 | 103 | 336 | 755 | 1080 | 1113 | 1138 | 36% | 26% | 6% |
| 77 | Adana | 0 | 0 | 0 | 0 | 0 | 12 | 71 | 274 | 635 | 1024 | 1023 | 986 | 35% | 25% | 6% |
| 78 | Mersin | 0 | 0 | 0 | 0 | 0 | 2 | 42 | 170 | 480 | 943 | 1108 | 1148 | 31% | 21% | 4% |
| 79 | İskenderun | 0 | 0 | 0 | 0 | 0 | 0 | 8 | 78 | 311 | 809 | 1232 | 1258 | 25% | 15% | 2% |

REFERENCES:

- [1] De Saulles, T., "Bsria Guide: Free Cooling Systems", Bsria, Bg 8/2004, October 2004
- [2] Ashrae Handbook 2000 "Systems And Equipment, Chapter 36-38", Ashrae, 2000
- [3] Airedale Company Product Catalogue ([Http://Www.Airedale.Com](http://www.Airedale.Com))
- [4] Friterm A.S Company Technical documents and softwares (<http://www.friterm.com>)
- [5] ICS Company Product Catalogue (www.industrialcooling.co.uk)
- [6] Bulut H., Buyukalaca O., Yilmaz T., "Bin weather data for Turkey", Department of Mechanical Engineering / University of Cukurova, Applied Energy 70(2001) 135 -155
- [7] EUROVENT Rating Standard For Forced Convection Air Cooled Liquid Coolers "Dry Coolers" 7/C/003 – 2010
- [8] Hanbell Company Product Catalogue and software (www.hanbell.com)

Author Biography

Hasan ACÜL was born in Ayvalik, located in Aegean region of Turkey, in 1976. He graduated from Mechanical Engineering Department of Yıldız Technical University in 1999. He has worked in sales, manufacturing and R&D departments of several companies in Heating, Cooling, Air Conditioning and Refrigeration (HVAC-R) industry. Currently, he is working as Chief Engineer of Research and Development (R&D) Department in FRITERM A.S, Turkey and studying for his master's degree in Science and Technology Strategies Department at Gebze Institute of Technology. He is an active member of The Chamber of Mechanical Engineers in Turkey. Hasan Acül is married and has one daughter.